


IEA Heat Pump Centre
Ice Hotel 2006
Figures

Fig. 1 Chena Hot Springs Double Lift (Three Pressure) Absorption Refrigeration Cycle

3/20/2005

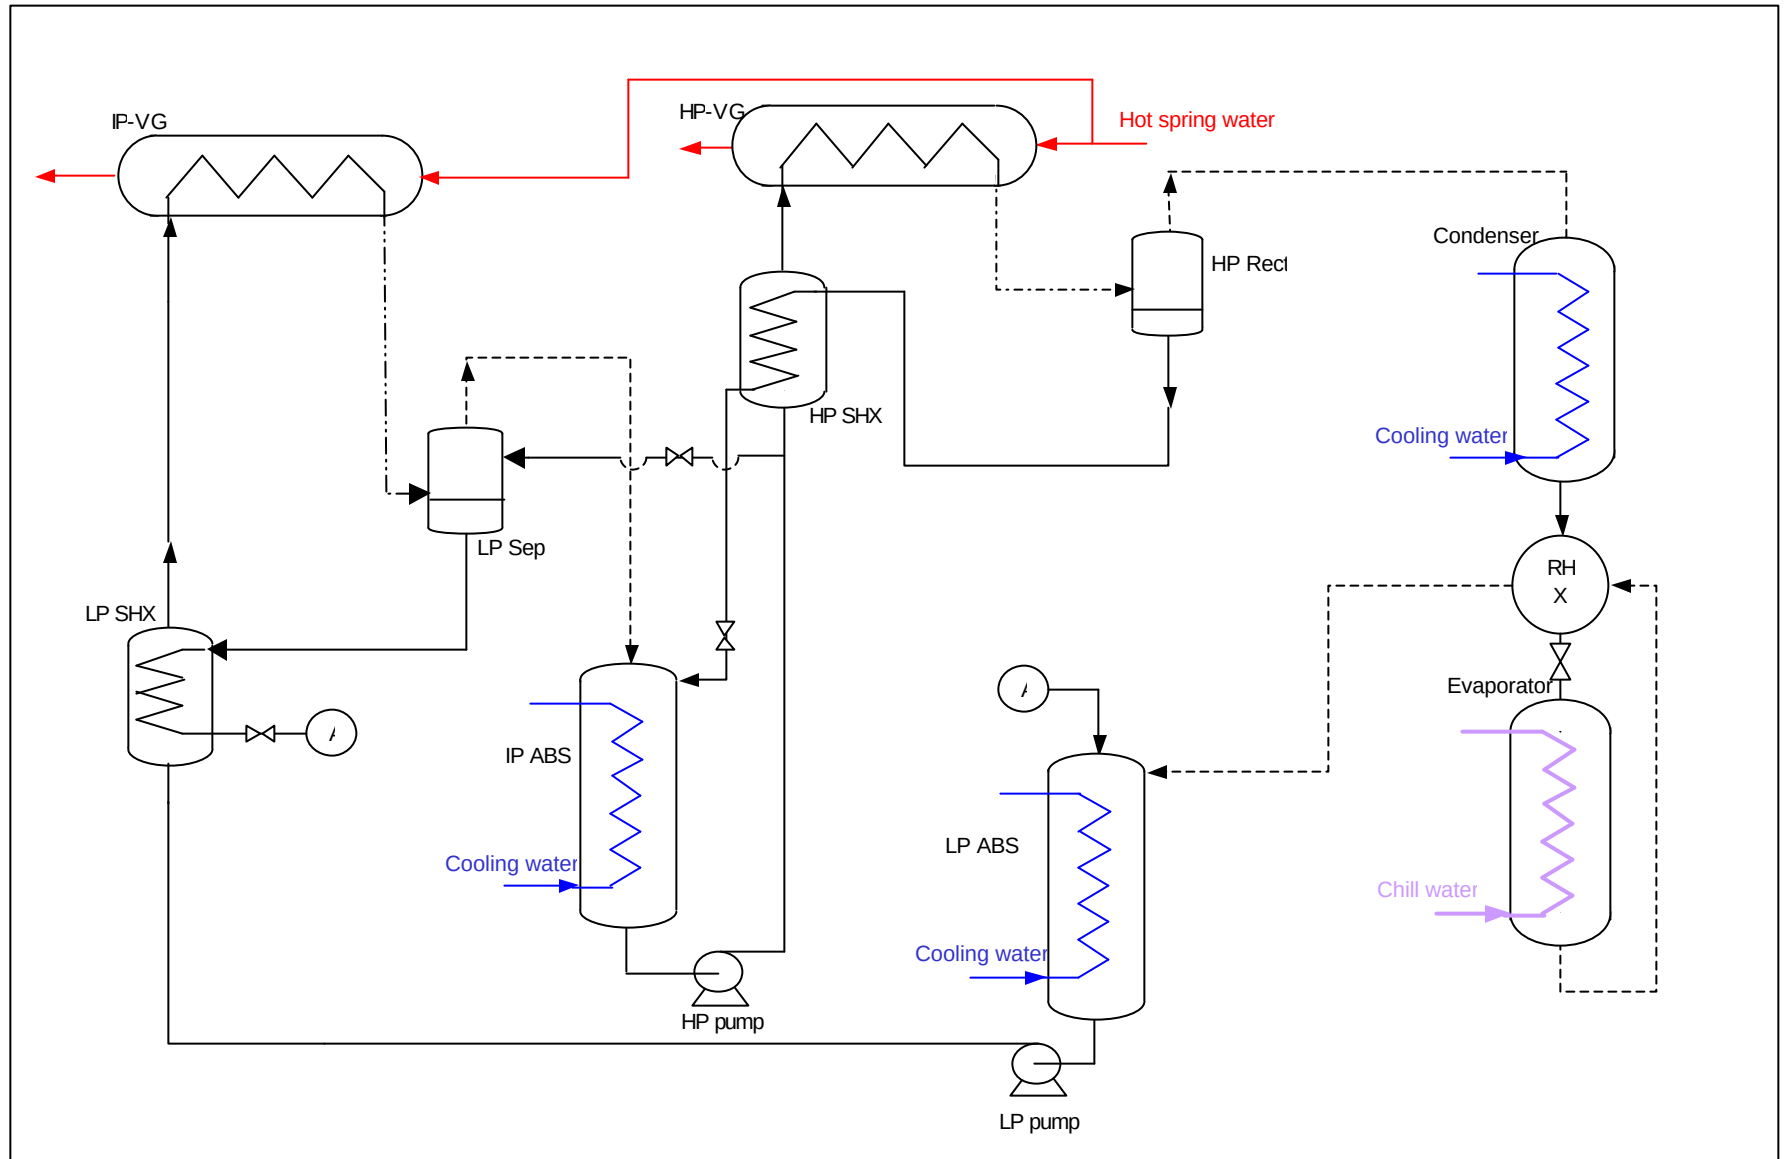

Energy Concepts Co.,



Fig. 2 Ice Hotel frozen in summer



Fig. 3 Double lift ThermoChiller prior to installation



Fig. 4 Interior View of Ice Hotel